DATASHEET - DILA-31(24VDC)



Contactor relay, 24 V DC, N/O = Normally open: 3 N/O, N/C = Normally closed: 1 NC, Screw terminals, DC operation



Part no.DILA-31(24VDC)Catalog No.276379Alternate CatalogXTRE10B31TDNo.EL-NummerKorway)4130206

Similar to illustration

Delivery program

Product range			DILA relays
Application			Contactor relays
Description			Basic devices with positive operation contacts
Connection technique			Screw terminals
Rated operational current			
AC-15			
220 V 230 V 240 V	le	А	4
380 V 400 V 415 V	l _e	А	4
Contacts			
N/O = Normally open			3 N/O
N/C = Normally closed			1 NC
Contact sequence			$\begin{array}{c} + & A1 \\ - & A2 \\ - & $
Code number and version of combination			
Distinctive number			31E
Can be combined with auxiliary contact module			DILA-XHI(V)
Actuating voltage			24 V DC
Voltage AC/DC			DC operation
Suppressor circuit			built-in
Connection to SmartWire-DT			yes in conjunction with DIL-SWD SmartWire DT contactor module
Instructions			Contact numbers to EN 50011 Coil terminal markings to EN 50005 built-in suppressor circuit'

Technical data

General			
Standards			IEC/EN 60947, EN 60947-5-1, VDE 0660, UL, CSA
Lifespan, mechanical			
DC operated	Operations	x 10 ⁶	20
Maximum operating frequency	Operations/h		9000
Climatic proofing			Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature			
Open		°C	-25 - +60
Enclosed		°C	- 25 - 40
Ambient temperature, storage		°C	- 40 - 80
Mounting position			

|--|

Mechanical shock resistance (IEC/EN 60068-2-27)			
Half-sinusoidal shock, 10 ms			
Basic unit with auxiliary contact module		g	
N/O contact		g	7
N/C contact		g	5
Degree of Protection			IP20
Protection against direct contact when actuated from front (EN 50274)			Finger and back-of-hand proof
Weight			
DC operated		kg	0.294
Terminal capacities		mm ²	
Screw terminals			
Solid		mm ²	1 x (0,75 - 4) 2 x (0,75 - 2,5)
Flexible with ferrule		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 2.5)
ein- oder mehrdrähtig		AWG	18 - 14
Stripping length		mm	10
Terminal screw			M3.5
Pozidriv screwdriver		Size	2
Standard screwdriver		mm	0.8 x 5.5 1 x 6
Max. tightening torque		Nm	1.2
Contacts			
Positive operating contacts to ZH 1/457, including auxiliary contact module			Yes
Rated impulse withstand voltage	U _{imp}	V AC	6000
Overvoltage category/pollution degree			III/3
Rated insulation voltage	Ui	V AC	690
Rated operational voltage	U _e	V AC	690
Safe isolation to EN 61140			
between coil and auxiliary contacts		V AC	400
between the auxiliary contacts		V AC	400
Rated operational current		A	
Conventional free air thermal current, 1 pole			
Open			
at 60 °C	I _{th} =I _e	A	16
AC-15	'th -'e	~	
220 V 230 V 240 V		A	4
	l _e		
380 V 400 V 415 V	le	A	4
500 V	le	A	1.5
DC current			
Notes			Switch-on and switch-off conditions based on DC-13, time constant as specified.
DC L/R ≦ 15 ms			
Contacts in series:		А	
1	24 V	А	10
1	60 V	А	6
2	60 V	А	10
1	110 V	А	3
3	110 V	А	6
1	220 V	A	1
3	220 V	A	5

DC L/R ≦ 50 ms			
Contacts in series:		A	
3	24 V	А	4
3	60 V	А	4
3	110 V	А	2
3	220 V	А	1
Control circuit reliability	Failure rate	λ	<10 ⁻⁸ , < one failure at 100 million operations (at U _e = 24 V DC, U _{min} = 17 V, I _{min} = 5.4 mA)
Short-circuit rating without welding			
Maximum overcurrent protective device			
220 V 230 V 240 V		PKZM0	4
380 V 400 V 415 V		PKZM0	4
Short-circuit protection maximum fuse			
500 V		A gG/gL	10
Current heat loss at I _{th}			
DC operated		W	0.85
Magnet systems			
Voltage tolerance			
DC operated			
Notes			Smoothed DC, three-phase bridge rectifiers or smoothed double-wave rectification
Pick-up voltage			0.8 1.1
at 24 V: without auxiliary contact component (40 °C)	Pick-up	x U _c	0.7 - 1.3
Power consumption			
DC operation			
DC operated	Pull-in =	W	3
	sealing		
duty factor		% DF	100
Changeover time at 100 % ${\rm U}_{S}$ (recommended value)			
DC operated closing delay		ms	
Switching times, DC operated, max. closing delay		ms	31
DC operated N/O contact opening delay		ms	
Switching times, DC actuated make contact Opening delay, max.		ms	12
Rating data for approved types			
Auxiliary contacts			
Pilot Duty			
AC operated			A600
DC operated			P300
General Use			
AC		V	600
AC		A	15
DC		V	250
DC		A	1

Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	А	15.5
Heat dissipation per pole, current-dependent	P _{vid}	W	1
Equipment heat dissipation, current-dependent	P _{vid}	W	0
Static heat dissipation, non-current-dependent	P _{vs}	W	3
Heat dissipation capacity	P _{diss}	W	0
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	60
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.

10.2.3.2 Verification of resistance of insulating materials to normal heat	Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects	Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Contactor relay (EC000196)


Rated control supply voltage Us at AC 50HZ V 0 - 0 Rated control supply voltage Us at AC 60HZ V 0 - 0 Rated control supply voltage Us at AC 60HZ V 24 - 24 Voltage type for actuating DC DC Rated operation current le, 400 V A 4 Connection type auxiliary circuit Screw connection Mounting method DIN-rail/screw Interface No Number of auxiliary contacts as normally closed contact 4 Number of auxiliary contacts as normally open contact Contact Number of auxiliary contacts as normally open contact, leading J With LED indication No Mumber of auxiliary contacts as change-over contact No					
Rated control supply voltage Us at AC 60HZ V 0 Rated control supply voltage Us at AC 60HZ V 0 Rated control supply voltage Us at AC 60HZ V 0 Rated control supply voltage Us at AC 60HZ V 0 Voltage type for actuating V 0 Rated operation current le, 400 V A A Connection type auxiliary circuit A A Mounting method Interface No Number of auxiliary contacts as normally closed contact A No Number of auxiliary contacts as normally closed contact, delayed switching Interface Interface Number of auxiliary contacts as normally closed contact, delayed switching Interface Interface Number of auxiliary contacts as normally closed contact, delayed switching Interface Interface Number of auxiliary contacts as normally closed contact, delayed switching Interface Interface Number of auxiliary contacts as normally closed contact, delayed switching Interface Interface Number of auxiliary contacts as normally closed contact, delayed switching Interface Interface Number of auxiliary contacts as normally closed contact, delayed switching Interface<	Electric engineering, automation, process control engineering / Low-voltage switch technology / Contactor (LV) / Contactor relay (ecl@ss10.0.1-27-37-10-01 [AAB716014])				
Rated control supply voltage Us at DC V 24 - 24 Voltage type for actuating DC Rated operation current Ie, 400 V A 4 Connection type auxiliary circuit Screw connection Mounting method DN-rail/screw Interface No Number of auxiliary contacts as normally closed contact Screw connection Number of auxiliary contacts as normally closed contact, leading 0 Number of auxiliary contacts as normally closed contact, leading O Number of auxiliary contacts as normally closed contact, leading Mounting Number of auxiliary contacts as normally closed contact, leading Mounting Number of auxiliary contacts as normally closed contact, leading Mounting Number of auxiliary contacts as normally closed contact, leading Mounting Number of auxiliary contacts as normally closed contact, leading Mounting Number of auxiliary contacts as normally closed contact, leading Mounting Number of auxiliary contacts as normally closed contact, leading Mounting Mumber of auxiliary contacts as normally closed contact, leading Mounting Mumber of auxiliary contacts as normally closed contact, leading Mounting Mumber of auxiliary	Rated control supply voltage Us at AC 50HZ	V	0 - 0		
Voltage type for actuating C Rated operation current le, 400 V A 4 Connection type auxiliary circuit Screw connection Mounting method IN-rail/screw Interface No Number of auxiliary contacts as normally closed contact Image: Contact of auxiliary contacts as normally closed contact, delayed switching Image: Contact of auxiliary contacts as normally closed contact, leading Number of auxiliary contacts as normally copen contact, leading Image: Contact of A With LED indication Image: Contact of A With LED indication Image: Contact of A	Rated control supply voltage Us at AC 60HZ	V	0 - 0		
Rated operation current le, 400 V A 4 Connection type auxiliary circuit Screw connection Mounting method IN-rail/screw Interface No Number of auxiliary contacts as normally closed contact Image: Strew connection Number of auxiliary contacts as normally closed contact Image: Strew connection Number of auxiliary contacts as normally closed contact, delayed switching Image: Strew connection Number of auxiliary contacts as normally open contact, leading Image: Strew connection Number of auxiliary contacts as normally open contact, leading Image: Strew connection Number of auxiliary contacts as normally open contact, leading Image: Strew connection Number of auxiliary contacts as normally open contact, leading Image: Strew connection Number of auxiliary contacts as normally open contact, leading Image: Strew connection Number of auxiliary contacts as normally open contact, leading Image: Strew connection Number of auxiliary contacts as normally open contact, leading Image: Strew connection Number of auxiliary contacts as change-over contact Image: Strew connection No Image: Strew contact Image: Strew contact Number of auxiliary contacts as change-over contact Image: Strew	Rated control supply voltage Us at DC	V	24 - 24		
Connection type auxiliary circuit Screw connection Mounting method DIN-rail/screw Interface No Number of auxiliary contacts as normally closed contact Screw connection Number of auxiliary contacts as normally closed contact Interface Number of auxiliary contacts as normally closed contact, delayed switching Interface Number of auxiliary contacts as normally closed contact, leading Interface Number of auxiliary contacts as normally closed contact, leading Interface Number of auxiliary contacts as normally closed contact, leading Interface Number of auxiliary contacts as normally closed contact, leading Interface Number of auxiliary contacts as normally closed contact, leading Interface Number of auxiliary contacts as normally closed contact, leading Interface Number of auxiliary contacts as normally closed contact, leading Interface Number of auxiliary contacts as normally closed contact, leading Interface Number of auxiliary contacts as normally closed contact, leading Interface Number of auxiliary contacts as change-over contact Interface Number of auxiliary contacts as change-over contact Interface Number of auxiliary contacts as change-over contact <	Voltage type for actuating		DC		
Mounting method Interface DIN-rail/screw Number of auxiliary contacts as normally closed contact Interface No Number of auxiliary contacts as normally closed contact Interface Interface Number of auxiliary contacts as normally closed contact Interface Interface Number of auxiliary contacts as normally closed contact, delayed switching Interface Interface Number of auxiliary contacts as normally open contact, leading Interface Interface With LED indication Interface Interface Interface Number of auxiliary contacts as normally open contact Interface Interface Number of auxiliary contacts as normally open contact, delayed switching Interface Interface Number of auxiliary contacts as normally open contact, leading Interface Interface With LED indication Interface Interface Interface Number of auxiliary contacts as change-over contact Interface Interface Interface Number of auxiliary contacts as change-over contact Interface Interface Interface Interface Number of auxiliary contacts as change-over contact Interface Interface Interface In	Rated operation current le, 400 V	А	4		
Interface No No Number of auxiliary contacts as normally closed contact delayed switching Number of auxiliary contacts as normally closed contact, delayed switching Number of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of auxiliary contacts as normally open contact, leading Minter of Auxiliary Contacts as normally open contact, leading Minter of Auxiliary Contacts as normally open contact, leading Minter of Auxiliary Contacts as normally open contact, leading Minter of Auxiliary Contacts as normally open contact, leading Minter of Auxiliary Contacts as normally open contact, leading Minter of Auxiliary Contacts as normally open contact, leading Minter of Auxiliary Contacts as normally open contact, leading Minter of Auxiliary Contacts as normally open contact (Minter of Auxiliary Contacts as normally Contacts as normally open contact (Minter of Auxiliary Contacts as normally Contacts	Connection type auxiliary circuit		Screw connection		
Number of auxiliary contacts as normally closed contact I Number of auxiliary contacts as normally open contact I Number of auxiliary contacts as normally closed contact, delayed switching I Number of auxiliary contacts as normally open contact, leading I Number of auxiliary contacts as normally open contact, delayed switching I Number of auxiliary contacts as normally open contact, leading I Vith LED indication I Number of auxiliary contacts as change-over contact I	Mounting method		DIN-rail/screw		
Number of auxiliary contacts as normally open contact Image: Contact is a normally open contact, delayed switching Image: Contact is a normally contact, delayed switching Image: Contact is a normally open contact, leading Image: Contact is a normaly open contact, leading Image: Contact is a normal i	Interface		No		
Number of auxiliary contacts as normally closed contact, leading 0 With LED indication 0 Number of auxiliary contacts as change-over contact 0 Output 0	Number of auxiliary contacts as normally closed contact		1		
Number of auxiliary contacts as normally open contact, leading 0 With LED indication No Number of auxiliary contacts as change-over contact Image: Contact to the co	Number of auxiliary contacts as normally open contact		3		
With LED indication No Number of auxiliary contacts as change-over contact O	Number of auxiliary contacts as normally closed contact, delayed switching		0		
Number of auxiliary contacts as change-over contact	Number of auxiliary contacts as normally open contact, leading		0		
	With LED indication		No		
Manual operation possible No	Number of auxiliary contacts as change-over contact		0		
	Manual operation possible		No		

Approvals


Product Standards	IEC/EN 60947-4-1; UL 508; CSA-C22.2 No. 14-05; CE marking
UL File No.	E29184
UL Category Control No.	NKCR
CSA File No.	012528
CSA Class No.	3211-03
North America Certification	UL listed, CSA certified
Specially designed for North America	No

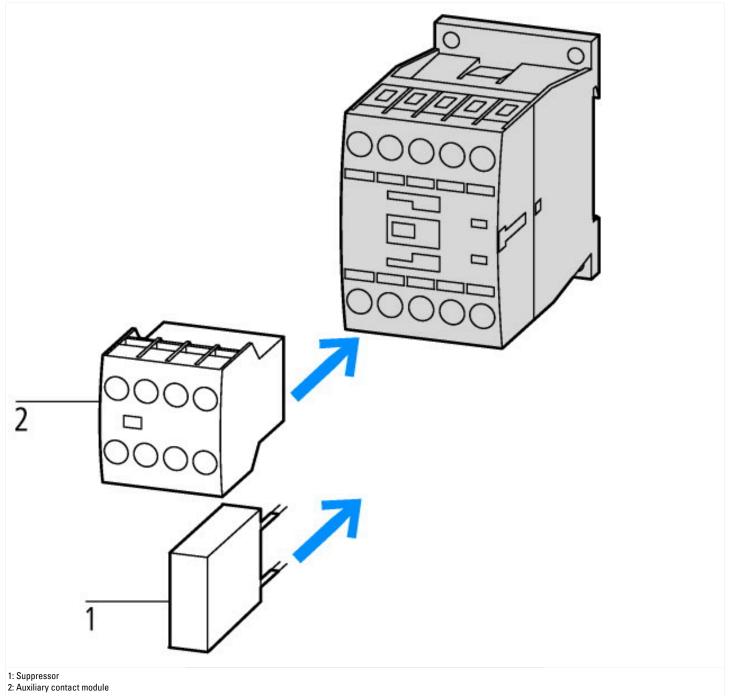


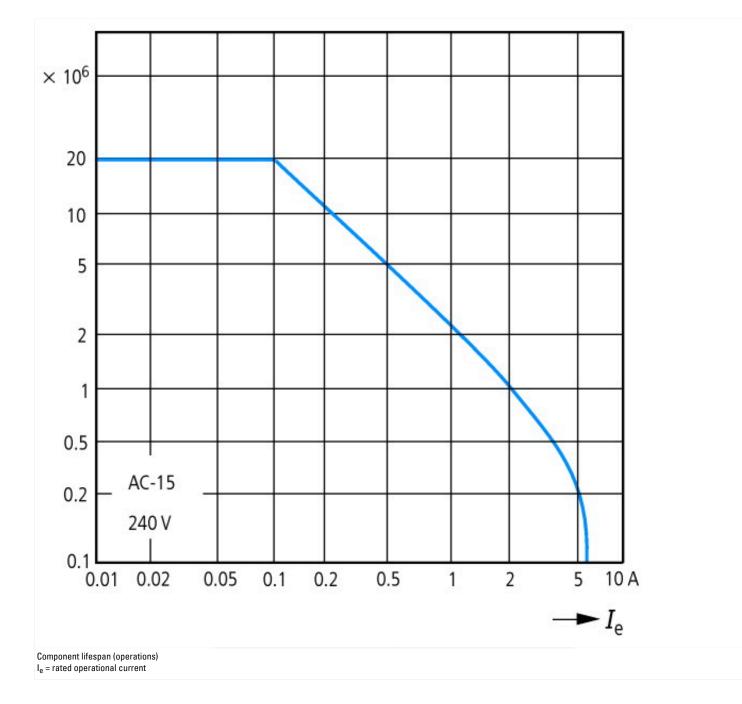

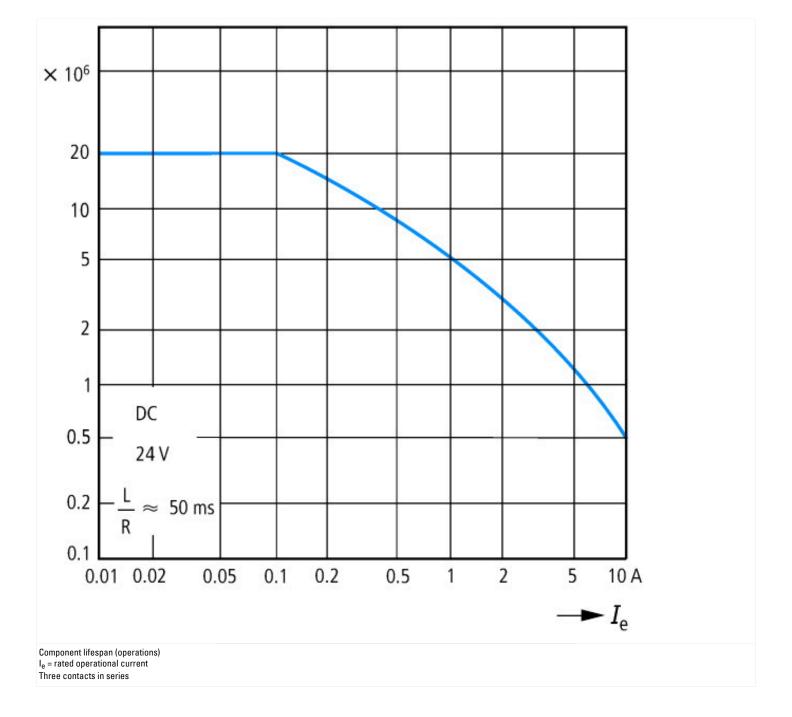

Dimensions

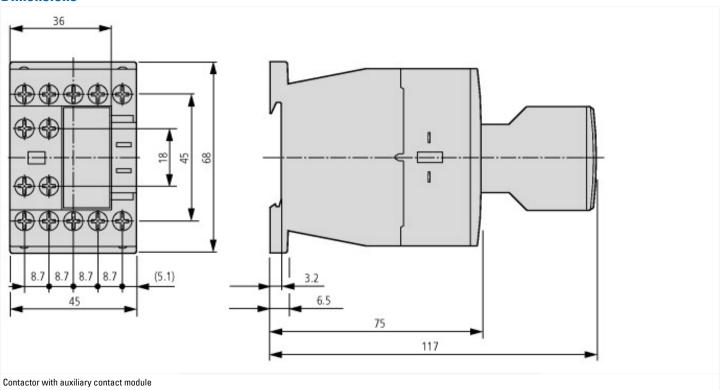

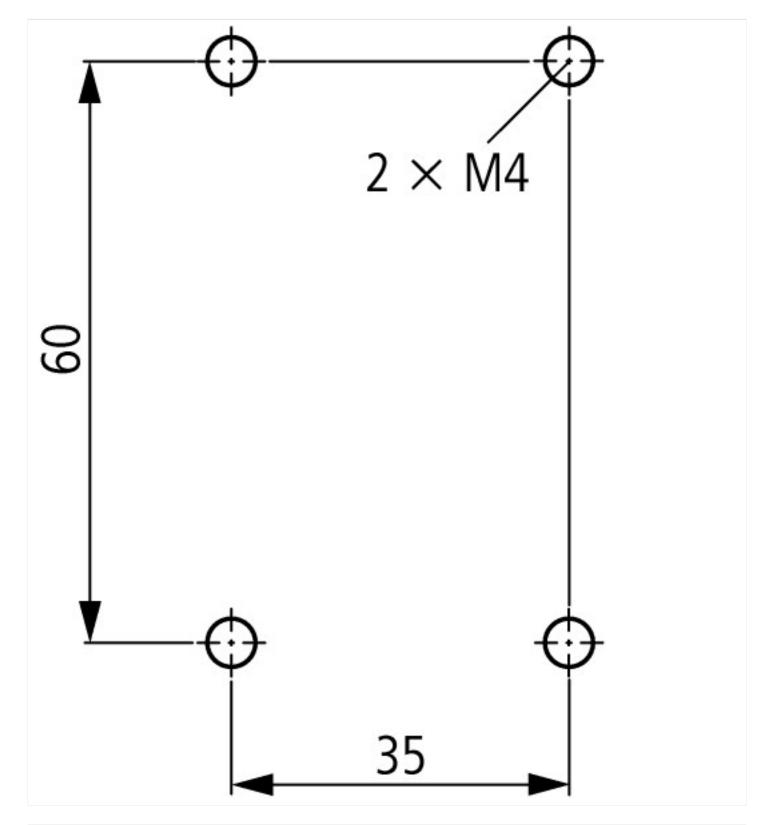

Assets (links)

Declaration of CE Conformity 00002875 Instruction Leaflets IL03407013Z2018_07

Additional product information (links)

IL03407013Z (AWA2100-2126) Contactors

IL03407013Z (AWA2100-2126) Contactors ftp://ftp.moe

 $ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL03407013Z2018_07.pdf$